Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS



# CLINTON REGIONAL HOSPITAL

PREPARED FOR:

**BRIAN BAKER**

Presented By:
Sean O'Brien
(405) 440-9201

sobrien@cliffordpower.com

CLIFFORD
POWER

**YOUR PARTNER IN DEPENDABLE POWER**

Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS






# Planned Maintenance (PM) Agreement

Clifford Power System, Inc ("CPS") agrees to provide Clinton Regional Hospital ("Customer"), located at 100 N 30th St. Clinton, OK 73601, and Customer agrees to accept and pay for, parts and service necessary to perform periodic Planned Maintenance ("PM") of ("Equipment").

## Payment Schedule

| Year | Aug | Sep | Oct | Nov | Dec | Jan | Feb | Mar | Apr | May | Jun | Jul | Total |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| 1 | $4,813 | | | | | | | | | | | | $4,813 |

## Equipment PM Items and Optional Services

**Service Location: Clinton Regional Hospital - 100 N 30th St. - Clinton, OK 73601** **Location Total: $4,813**

ONAN 400kW

### Included PM Items

- ✓(1) 99-Point Inspection & Test
- ✓(1) Engine Service
- ✓(1) LoadBank - 4 Hours
- ✓(1) Fuel Sampling (DFQ)
- ✓(1) ATS In-Depth Maintenance

## Terms & Conditions

This proposal will expire on August 21, 2026.

This agreement will be in accordance with the following terms and conditions for a period of 1 year. Coverage dates are 08/01/2026 to 07/31/2027. In consideration of the agreements herein contained:

1. **Customer agrees to:** Remit Amount of $4,813 for the first year of Planned Maintenance. Any optional Planned Maintenance service that the customer chooses to accept will be invoiced, in addition to the original Planned Maintenance fee, at the time the service is provided. Customer agrees to make payment upon receipt of invoice.
2. **CPS agrees to:** Perform Preventative Maintenance inspections and optional Preventative Maintenance items agreed to in this proposal. Work is to be performed during regular business hours 8:00 AM – 5:00 PM Monday through Friday.

   Customer will receive a copy of the CPS maintenance inspection report with all applicable areas filled out by the service technician. CPS shall also report any noted problems with Equipment and recommended courses of corrective action to the Customer.
3. **Customer also authorizes:** CPS to perform repairs deemed necessary for proper operation of the standby power system at time of inspection. The cost of repairs shall not exceed $0 without customer authorization, and shall be documented on the inspection report. Repairs estimated to exceed this amount will be referred to the Customer for action and additional authorization.

Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS






4. **Customer also authorizes:** CPS to perform a Diesel Fuel Top Off Service for an amount not to exceed $0 without customer authorization. This service shall be documented on the inspection report. Cost for fuel service will be invoiced separately at CPS prevailing labor and fuel rates. Service Trucks are capable of providing up to 100 gallons, if approved pricing covers costs.
5. **CPS warrants its work:** For a period of 30 days from the date of service. This warranty is limited to failure as a result of workmanship and does not include failures resulting from improper or unauthorized installation, misuse, negligence, accident, over-loading, over-speeding, repairs made by someone other than CPS, fire, flood, vandalism, theft or any other acts beyond the control of CPS, while under agreement.
6. **Failures of new parts installed by CPS:** Failure of any new part(s) installed by CPS during the course of maintenance service shall be covered by the manufacturer's warranty of said part(s).
7. **Renewal:** This agreement will automatically renew annually unless cancelled per Paragraph 8.
8. **Cancellation:** This agreement may be cancelled by either party with a 60 day written notification.
9. **Registration/Training Fees:** If Buyer requires Seller to register with an entity, or incur additional costs such as licensing or training specific to the servicing requirements of Buyer's account, then Buyer agrees to reimburse Seller all costs affiliated with these fees. Costs include direct fees for registration plus 20% for Seller's administration.
10. **Limit of Liability:** Clifford Power System, Inc.'s liability under this agreement, if any, shall be limited to the contract amount of this agreement in no event shall CPS be liable for any consequential, incidental or exemplary damages, including, but not limited to, loss of profits or down time.

Clifford Power Systems and Customer have agreed to the above this day.

| | | | |
|---|---|---|---|
| By Sean O'Brien | Date Jul 22 2026 | By _____ | Date _____ |
| Clifford Power Systems-Representative | | Customer-Representative | |

H3L0CC

Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS

CLIFFORD POWER

# Service Level Checks – Annual Planned Maintenance

## 99-POINT INSPECTION – TO BE PERFORMED ANNUALLY

### ENGINE ELECTRICAL (STARTING SYSTEM)

- **Batteries** – Check battery water level, age, specific gravity & perform load test. Clean batteries externally including cables & posts.
- **Alternator** – Visually inspect alternator & alternator belt. Measure & record alternator DC voltage output.
- **Glow Plugs** (where applicable) – Check for proper operation.
- **Battery Charger** – Visually inspect, measure & record DC voltage output.
- **Starting Motor** – Visually inspect, test for proper operation (Performed during engine start).
- **Spark Plugs** (where applicable) – Check spark plugs & spark plug wires condition & annotate recommendations for repair or replacement.
- **Distributor Cap** – (where applicable) – Inspect. Annotate recommendations for repair or replacement.

### GENERATOR

- **Windings** – Visually inspect windings.
- **Bearings** – Inspect for proper lubrication.
- **Brushes/Diodes** – Visually inspect for wear.
- **Leads/Connections** – Visually inspect for wear.
- **Circuit Breaker** – Test for proper operation.
- **Mounts/Bolts** – Visually inspect for wear and/or damage.
- **Noise** – Annotate operational noise indicators of mechanical malfunctions.

### SAFETY CONTROLS / CONTROL PANEL

- **Voltage** (where applicable) – Measure & record loaded & unloaded AC voltage.
- **Frequency** (where applicable) – Measure & record loaded & unloaded Hertz frequency.
- **Amperage** (where applicable) – Measure & record loaded amperage.
- **Auto Start/Stop** – Check for proper operation. If allowed, check for automatic start.
- **Shutdowns** – Visually inspect for wiring deterioration. Verify proper operation of shutdowns.
- **Pre-alarms** – Verify proper annunciation of pre-alarms.
- **Remote Annunciator** (where applicable) – Inspect for proper operation.

### INSTRUMENTATION

- **Oil Pressure Gauge** – Check for proper operation. Measure & record oil pressure PSI.
- **Water Temperature Gauge** – Check for proper operation. Measure & record water temperature in degrees Fahrenheit.
- **Ammeter -** Check for proper operation. Measure & record amperage in DC amps.
- **AC Electric Meters -** Check for proper operation. Measure & record readings.
- **Control Panel Wiring** – Visually inspect for signs of wear & correct observed loose connections.

### AIR INDUCTION & EXHAUST

- **Precleaner** – Visually inspect condition & clean when necessary.
- **Air Filter** – Inspect & clean air filter. Recommend replacement when necessary. Note condition of filter housing.
- **Intake** – Visually inspect & note condition of intake piping & gaskets.
- **Turbocharger** – Visually inspect turbocharger for leaks, physical condition, & annotate auditory indicators of wear.
- **Exhaust/Silencer** – Visually inspect for leaks & proper operation including rain cap (where applicable). Annotate anomalies in exhaust smoke.

Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS

## LUBRICATION SYSTEM

- **Lubrication Oil** – Check for proper oil level.
- **Crankcase Breather** – Clean breather (where applicable). Annotate condition & any excessive blow by.
- **Governor** – Check oil level.
- **Tubes, Lines, Seals & Gaskets** – Visually inspect for deterioration or indications of wear.

## COOLING SYSTEM

- **Radiator –** Visually inspect radiator core condition, annotate indications of coolant leakage or core blockage. Check coolant level.
- **Radiator Cap** – Check for indications of wear.
- **Coolant** – Measure & record antifreeze freeze point & PH level.
- **Hoses** – Visually inspect hoses, clamps, gaskets & connections.
- **Fan Assembly** – Visually inspect fan, fan bearing, pulleys & belts for indications of wear. Measure belt tension for proper operation.
- **Water Pump** – Visually inspect for proper operation, leaks, or audible indications of wear.
- **Jacket Water Heater** – Inspect for proper operation, indication of wear on heater & associated hoses & clamps.
- **Thermostat** – Check for proper operation

## FUEL SYSTEM

- **Fuel Lines & Connections** – Visually inspect for proper operation & indications of deterioration.
- **Priming Pump** (where applicable) – Verify proper operations & inspect for seal damage or deterioration.
- **Fuel Filters** – Visually inspect for damage, leaks, & proper operation.
- **Governor & Controls** – Inspect controls & linkage for proper operation.
- **Carburetor/Mixer** – Visually inspect & verify proper operation.
- **Day Tank/Fuel Cell** – Visually inspect for leaks & check for proper operation. Make note of water in fuel cell & level of fuel.

## ATS

- **Wiring & Contacts** – Visually inspect.
- **Connections Temp.** – Check temperature of connections with infrared temperature gun.
- **Contactor Operation** – If allowed, perform simulated power failure to test operation of contactor.
- **Timers & Controls** – Observe all time delays during simulated test.

# 99-POINT INSPECTION & ENGINE SERVICE – TO BE PERFORMED ANNUALLY

## ENGINE SERVICE INCLUDES:

- **Fuel System** – Fuel filter & fuel/water separator filter replacement. Check for proper seal & operation.
- **Lubricating System** – Replace oil filters. Inspect all gaskets & seals. Remove existing lubricating oil & dispose. Fill with fresh engine oil, Oil sampling analyzed by independent laboratory.
- **Generator** – Lubricate bearings if applicable.

CLIFFORD POWER

CUSTOMER PORTAL

View your generator maintenance documentation with our Customer Portal

GENERATOR: EQUIPMENT, SERVICE, RENTAL


cliffordpower.com | 1-800-324-0066

H3L0CC

Revised 06-19-25

4805 Dougherty Pl, Oklahoma City, OK 73179

(405) 440-9201

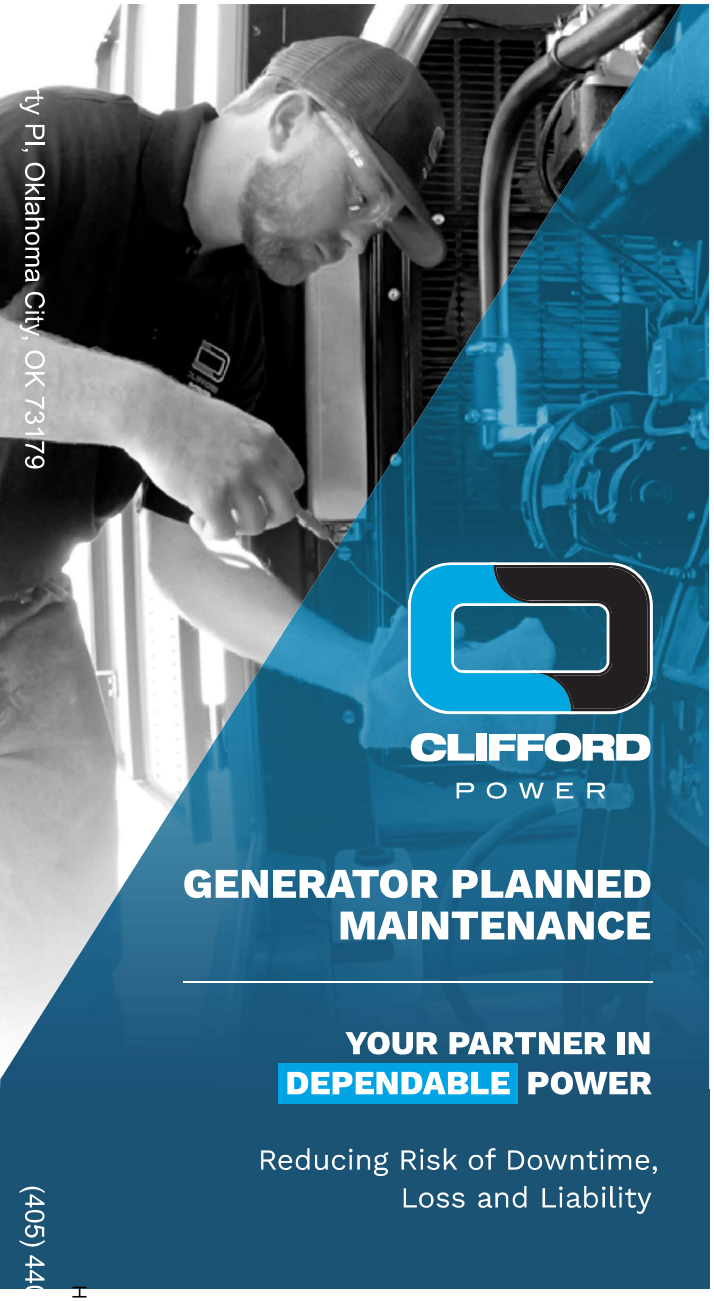

CLIFFORD
POWER

# GENERATOR PLANNED MAINTENANCE

**YOUR PARTNER IN DEPENDABLE POWER**

Reducing Risk of Downtime, Loss and Liability

ty Pl, Oklahoma City, OK 73179


(405) 44

H3L0CC

## WILL YOUR GENERATOR PERFORM DURING AN EXTENDED OUTAGE?

And what are the consequences if it fails? **Load bank testing** verifies 100% performance of your generator. It's the best method of confirming whether or not your system is capable of operating at capacity during an extended power outage.

- Beneficial for both gas and diesel generators
- Confirms cooling system operation
- Exposes hidden performance issues
- Eliminates wet-stacking and carbon build-up on diesel engines

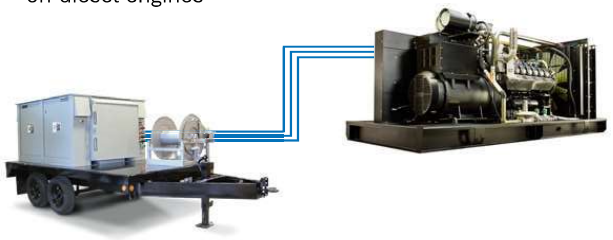

## WE CAN PROTECT YOUR DIESEL FUEL

Filling a diesel generator tank is a costly investment. Standby generator fuel is stored for long periods of time, causing fuel degradation, which can lead to equipment failure. We offer solutions to protect your investment.

- Diesel fuel treatment
- Diesel fuel testing
- Diesel fuel polishing
- Diesel fuel top-off


## ELECTRICAL SYSTEM RELIABILITY

We offer in-depth services to maintain the electrical system integrity for critical generator applications.

- Thermal imaging
- Megger testing
- Dead buss ATS service

## REMOTE MONITORING SYSTEMS

Receive real-time notifications and check status from your desktop, tablet and smartphone.

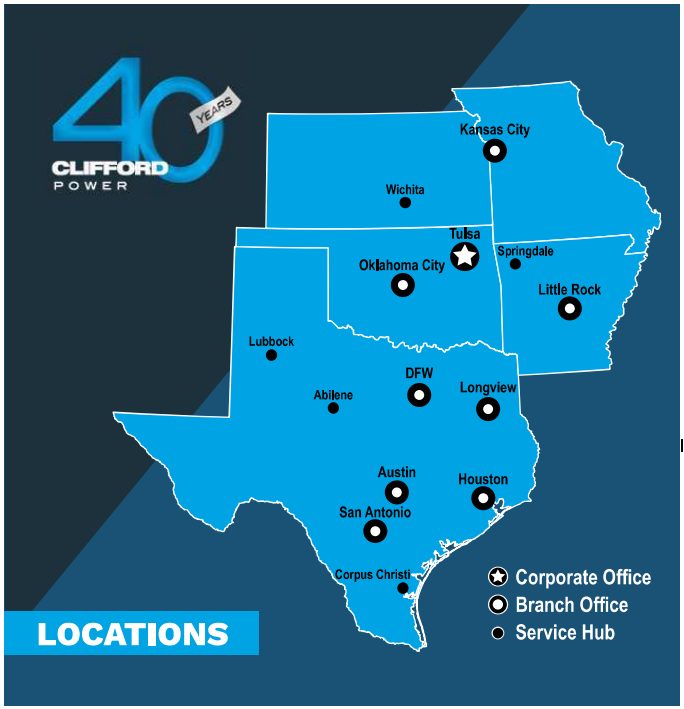


## LOCATIONS

## THE CLIFFORD ADVANTAGE

- We service all makes and models
- Available 24/7/365
- Largest technician team in the south-central U.S.
- Solely focused on power generation
- Code compliancy consultants
- Family owned since 1985

**GENERATOR**
EQUIPMENT • SERVICE • RENTAL • PARTS

**cliffordpower.com • 1-800-324-0066**

**PURCHASING COOPERATIVE PARTNERS**

TIPS AWARDED VENDOR

Available on BuyBoard Cooperative Purchasing

Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS

## YOUR POWER IS OUR PRIORITY

Proactive maintenance is the key to reliability for your standby generator. We offer customized maintenance plans to meet your specific generator system needs, and our service team is available 24/7/365.

- We make it easy to do business with a smooth, hassle-free service experience from start to finish.
- We provide the most comprehensive inspection in the business. Our technicians conduct a 99-point inspection covering the entire standby generator system.
- We keep you protected by identifying issues before they become costly problems.
- We leave your equipment cleaner than we found it.
- We offer a completely paperless process to keep reporting information accurate and prompt.

## TRUE GENERATOR TECHNICIANS

We service all generator makes and models, and our technicians are certified through the Electrical Generating Systems Association (EGSA), the only nationally recognized power generation association.

## WE KEEP YOU COMPLIANT

With over 40 years of expertise on national and local standards, we help you avoid code compliancy issues while keeping your equipment safe and operational.

## INFO AT YOUR FINGERTIPS

Our Customer Portal provides generator maintenance documentation and Emergency Power Plans in real-time.

CUSTOMER PORTAL

## GENERATOR PLANNED MAINTENANCE SCHEDULE

MORE CRITICAL → LESS CRITICAL

| | The Joint Commission<br>Failure could result in loss of life | NFPA 110<br>Failure could result in loss of life | Non-Regulated Business<br>No life risk | Residence<br>No life risk |
|---|---|---|---|---|
| Weekly Exercise | Weekly (automatic) | Weekly (automatic) | Weekly (automatic) | Weekly (automatic) |
| Weekly Inspections | Weekly (Use Clifford NFPA log) | Weekly (Use Clifford NFPA log) | Weekly | Weekly |
| 30 Minute Transfer Test | Monthly (Use Clifford NFPA log) | Monthly (Use Clifford NFPA log) | Monthly | Monthly |
| 99 Point Inspection | Quarterly | Quarterly | Semi-Annually | Annually |
| Engine Service & Oil Sample Test (Includes Lab analysis) | Annually | Annually | Annually | Annually |
| Replace Batteries | Every 2 Years | Every 2 Years | Every 2 Years | Every 2-Years |
| 2-Hour Load Bank | Annually | Annually | Annually | As Recommended |
| 4-Hour Load Bank | Every 3 Years | Every 3 Years | Every 3 Years | As Recommended |
| Diesel Fuel Sample Test (Includes Lab Analysis) | Annually (TJC spec) | Annually (NFPA spec) | Annually | As Applicable |
| Triennial Service (Belts/Hoses/Coolant) | Every 3 Years | Every 3 Years | Every 3 Years | As Recommended |
| Replace Air Filter | Every 3 Years | Every 3 Years | Every 3 Years | As Recommended |
| Coolant Sample Test (Includes Lab Analysis) | As Recommended by Planned Maintenance Consultant | | | |
| Diesel Fuel Treatment | As Recommended by Planned Maintenance Consultant | | | |
| Diesel Fuel Polishing | As Recommended by Planned Maintenance Consultant | | | |
| Diesel Fuel Top-Off | As Recommended by Planned Maintenance Consultant | | | |
| Megger Testing | As Recommended by Planned Maintenance Consultant | | | |
| Dead Buss ATS Service | As Recommended by Planned Maintenance Consultant | | | |
| Thermal Imaging | As Recommended by Planned Maintenance Consultant | | | |
| Remote Monitoring | When Alerts and Visibility are Desired | | | |

Required by TJC or NFPA Standards

H3L0CC

Zoho Sign Document ID: 3330EDDD-EDJFO40NUNNYLQYQ_UPQKXRGNZ6UKVIWXEKPO4GBFYS